


NOTE:
1. REMOVE JUMPER WHEN CONNECTING A SECOND REMOTE PANEL.

NOTE:
○ REMOTE CONECTOR PINS

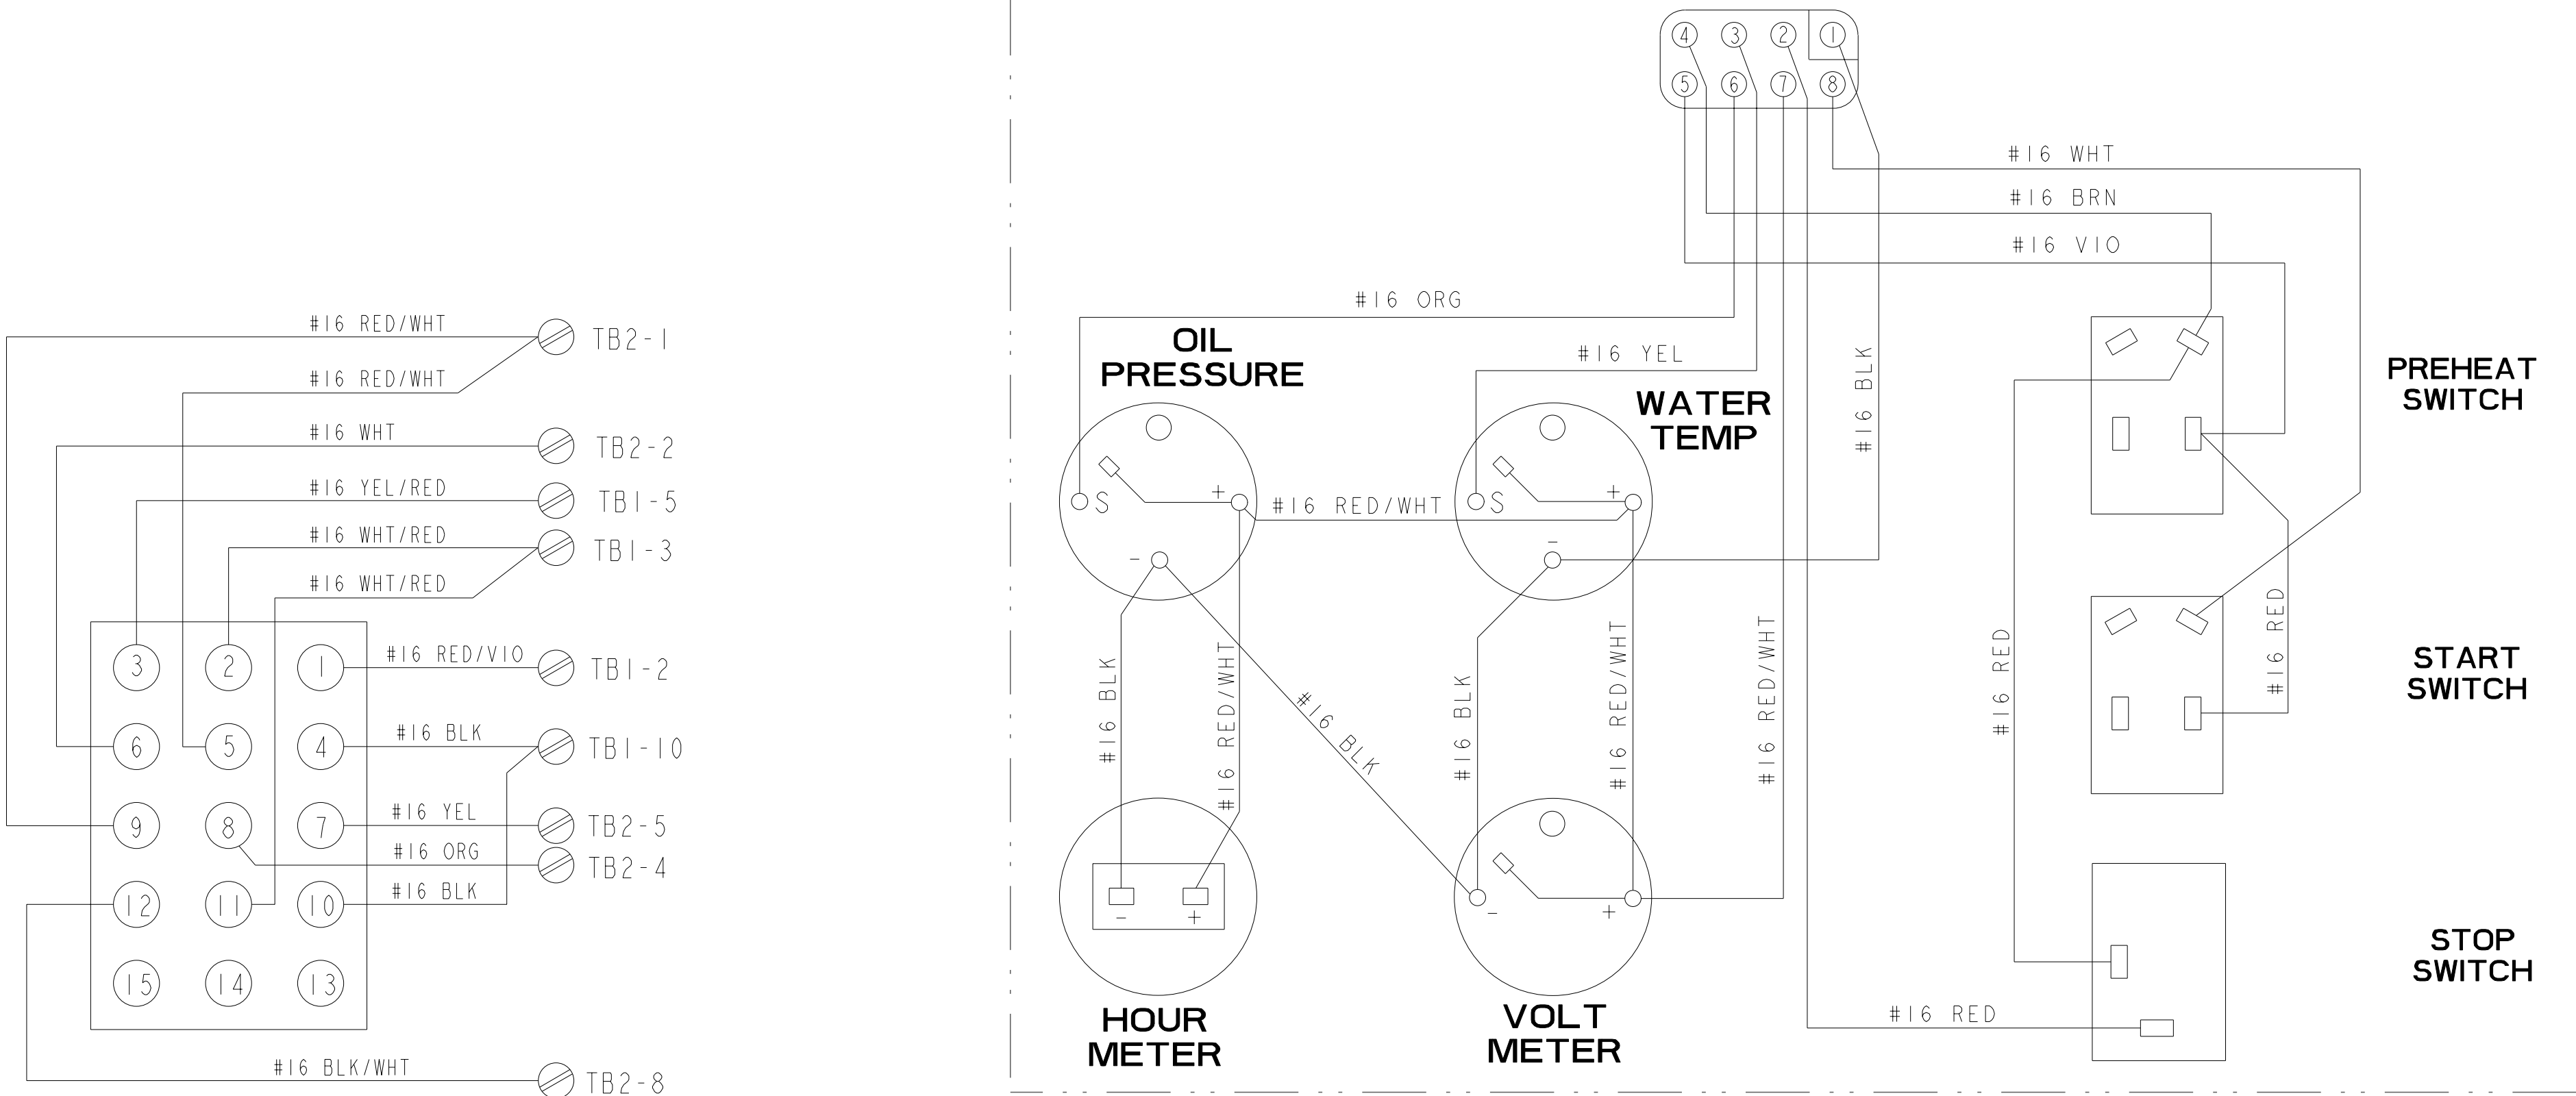

INSTRUMENT PANEL

ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY

4737	1/1/6	B	#10 ORANGE WAS #10 RED, #12 VIO/RED WAS #12 VIO ROUTED WIRE FROM PREHEAT SOLENOID TO STARTER	JRS	
4632	7/12/00	A	UPDATED ALTERNATOR WIRING SCHEMATIC. WIRE #10 RED WAS #10 ORN. WIRE #12 VIO WAS #12 VIO/RED. WIRE #12 RED ROUTED FROM STARTER TO 20 AMP CIRCUIT BREAKER.	TSM	

TOLERANCES (UNLESS OTHERWISE NOTED)		WESTERBEKE CORPORATION AVON MA. 02322	
INCHES	MILLIMETERS	TITLE	
XX : .00	XX :	WIRING DIAGRAM/SCHEMATIC, 7.6 BTDR - SRC	
XX : .005	XX :	DRWN	DATE
XX : .01	XX :	JPG	16/MAY/00
XX : .02	XX :	APPROVED BY	DATE
XX : .03	XX :	TSM	
XX : .04	XX :	SCALE	NONE
XX : .05	XX :	SIZE	DRAWING NUMBER
XX : .06	XX :	SHT.	1 OF 1
XX : .07	XX :	REV.	
XX : .08	XX :		
XX : .09	XX :		
XX : .10	XX :		